



## Hazardous Location LED Luminaire

### FME Star-Series

## Product description

The Star-Series LED Luminaire can be used in locations made hazardous by the presence of flammable vapors or gases or combustible dusts as defined by the NEC. The Star Series is rated for Class 1, Division 1; Class 1, Division 2; Class 2, Division 2; Class 3 applications. The copper free cast aluminum housing allows for cool operating temperatures. L70=150,000 HOURS

## Features

- High efficacy: up to 140lm/W
- Color temperature: 4000K, 5000K, 6000K
- Input Voltage 120–277V or 347–480V
- Suitable for -40°C to +60°C Ambient Temperature.
- L<sub>70</sub> Rating of 150,000 hours
- Variable optics 40° 60° 90° 120° for uniform illumination
- CRI>70
- Standard ceiling mount
- Copper free aluminum
- High vibration resistance
- Low maintenance costs
- Standard 2ft cable out of 3/4" threaded hub on top of fixture

## Applications

- Coal & Dust Storage
- Petroleum Refineries
- Ethanol Facilities
- Chemical Plants
- Waste Water & Water Treatment Plants
- Power Generation Plants

## Warranty


- 5-year limited warranty on the fixture. Complete warranty <http://www.fmelighting.com/warranty.html>

**Note:** Actual performance may differ as a result of end-user environment and application.

## Compliance & Listing

- Class I, Division 1, Groups C & D
- Class I, Division 2, Groups A, B, C & D
- Class II, Division 1, 2, Groups E, F & G
- Class III
- UL 844 Hazardous Locations
- UL 1598 Wet Locations
- UL 1598A Marine Outside
- UL 8750 LED Safety
- CSA C22.2 No. 250.0-08
- CSA C22.2 No. 137-M1981
- IP66
- DLC Listed
- CNEX
- ATEX
- IECEX
- ATEX

## Product Dimensions



Model	A	B
Star Series	16"	12.7"

## Ceiling Mounted Bracket



Side View

Top View


\*\*Ceiling mounted bracket comes standard with the Moon, Star, Venus, Space and Mars Series.\*\*

## Explosion Proof Junction Box



\*\* EX-JBOX can be used with the Moon, Star, Venus, Space and Mars Series.\*\*

## 25° Wall Mount

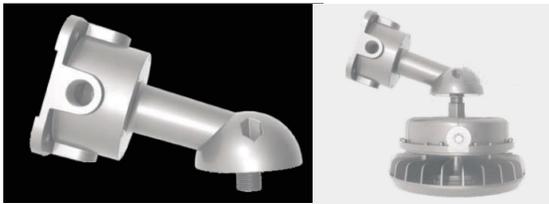

\*\*25 wall mount can be used with the Moon, Star, Venus, Space and Mars Series.\*\*

## 90° Wall Mount



\*\*90 wall mount can be used with the Moon, Star, Venus, Space and Mars Series.\*\*

## 25° Stanchion



## 90° Stanchion




\*\*Stanchion mount can be used with the Moon, Star, Venus, Space and Mars Series.\*\*

## Conduit 47(in)




## Photometric

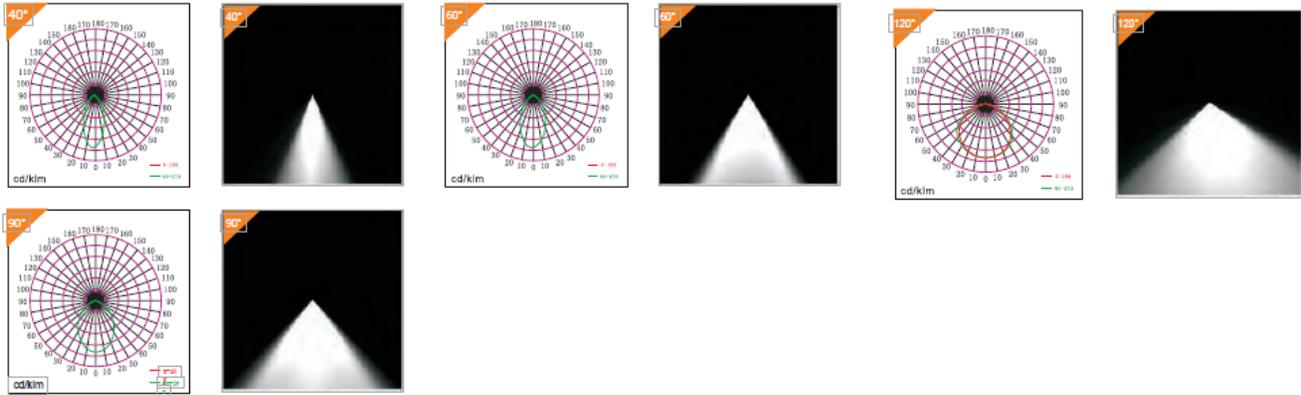

## Technical Parameter

Item No.	FME-STA-60	FME-STA-80	FME-STA-100	FME-MOO-150
Power	60W	80W	100W	150W
Input Voltage	AC100-277V or AC277-480V			
Lumen	8,400	11,200	14,000	21,000
Light Efficiency	140lm/W			
CCT	4000K, 5000K, 6000K			
CRI	>70			
IP Rating	IP66			
Certification	UL/ETL/IECEX/ ATEX			

## Ordering Information and Mounting Accessories

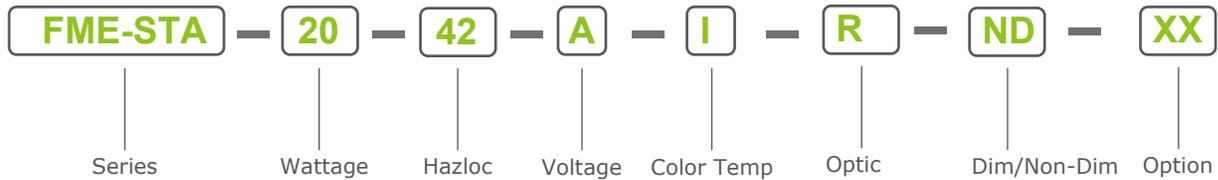

<u>SERIES</u>	<u>WATTAGE</u>	<u>HAZLOC</u>	<u>VOLTAGE</u>	<u>COLOR TEMP</u>	<u>OPTIC</u>	<u>DIM/NON-DIM</u>	<u>OPTION</u>
FME-STA	6=60W 8=80W 10=100W 15=150W 20=200W	42=CIDI 52=CID2 62=CIID1 72=CIID	A=AC100-277V B=AC277-480V	I= 4000K C= 5000K K= 6000K	M=40° N= 60° O= 90° P= 100° Q= 110° R= 120°	D=Dimmable ND=Non-Dimmable	OPDPS=250 Stanchion OPPS=90° Stanchion OPWA=250 Wall Mount OPCB=90° Wall Mount OPPP=Pendant Mount OPDPP=120 Pendant OPEB=Junction Box OPC= 47(in) Conduit OPG= Wire Guard OPDR= Dome Reflector OPAR=Angle Reflector

Class I locations are those in which inflammable gases or vapors are or may be present in sufficient quantities to produce explosive or flammable mixtures.

### CLASS I, DIVISION 1

Class I, Division 1 locations are where hazardous atmosphere may be present during normal operations. It may be present continuously, intermittently, periodically or during normal repair or maintenance operations, or those areas where a breakdown in processing equipment releases hazardous vapors with the simultaneous failure of electrical equipment.

### CLASS I, DIVISION 2

Class I, Division 2 locations are those in which volatile flammable liquids or gases are handled, processed or used. Normally they will be confined within closed containers or in closed systems from which they can escape only in the case of rupture or deterioration of the containers or systems.

## Class II Locations

Class II locations are those that are hazardous because of the presence of combustible dust.

### CLASS II, DIVISION 1

Class II, Division 1 locations include areas where combustible dust may be in suspension in the air under normal conditions in sufficient quantities to produce explosive or ignitable mixtures (Dust may be emitted into the air continuously, intermittently or periodically), or where failure or malfunction of equipment might cause a hazardous location to exist and provide an ignition source with the simultaneous failure of electrical equipment, included also are locations in which combustible dust of an electrically conductive nature may be present.

### CLASS II, DIVISION 2

Class II, Division 2 locations are those in which combustible dust will not normally be in suspension nor will normal operations put dust in suspension, but where accumulation of dust may interfere with heat dissipation from electrical equipment or where accumulations near electrical equipment may be ignited.

## Class III Locations

Class III locations are those considered hazardous due to the presence of easily ignitable fibers of flyings, which are in quantities sufficient to produce ignitable mixtures.

### CLASS III, DIVISION 1

Locations in which easily ignitable fibers or materials producing combustible flyings are handled, manufactured or used.

### CLASS III, DIVISION 2

Locations where easily ignitable fibers are stored or handled.